

NOT	ÄNDRING	INFÖRD	SIGN

EXAMPLE  
SINGLE-LINE DIAGRAM  
Low voltage switchgear LV Type 1



SECONDARY SUBSTATION LV Type 1

Attachment 1


SWITCHGEAR

KONSTR.	KJS	RIT.	KJS
KOLL.	HRo	GODK.	
SKALA		DAT.	2023-10-23

Single-line diagram

ERS.	
BLAD	1
FORTS.BLAD	-

0,5 kV

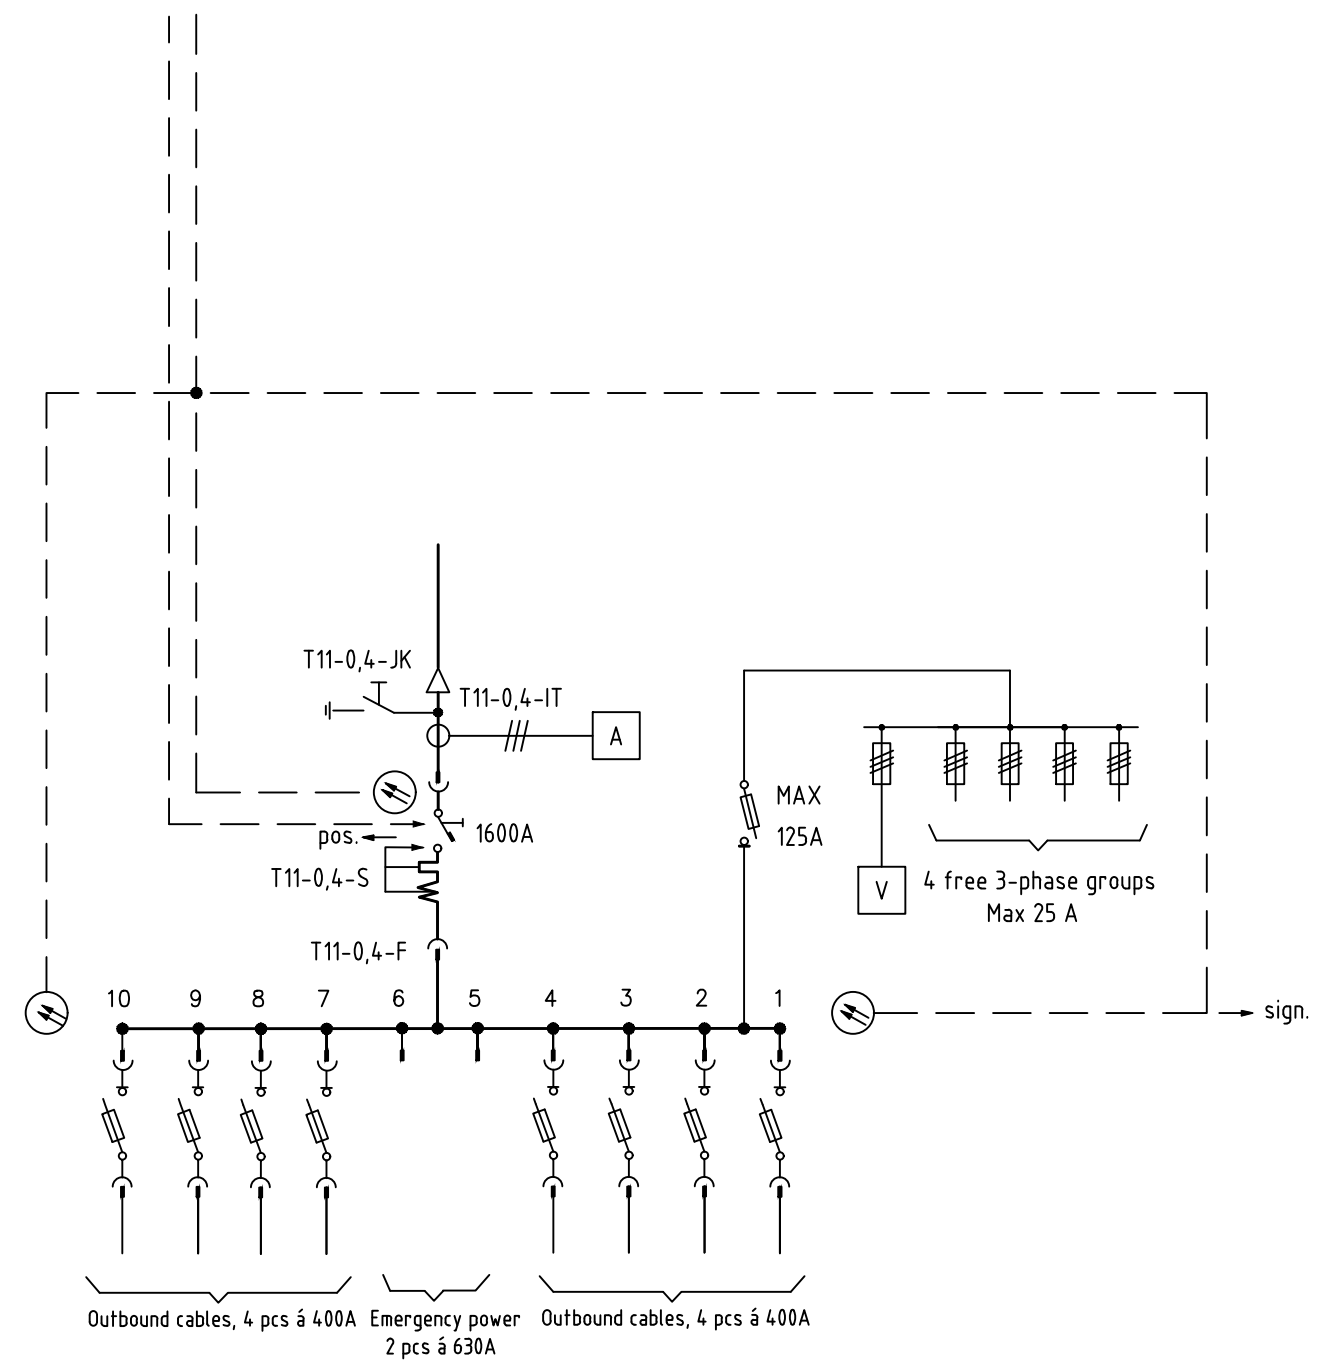

- Three phase voltage measurement connected to the RTU
- Current measurement connected to the RTU
- Maneuver from RTU
- Double point position of Beraker/Load disconnect
- Signal/Alarm